




BCRSD - NEW SEWER MAIN (2021-2026)

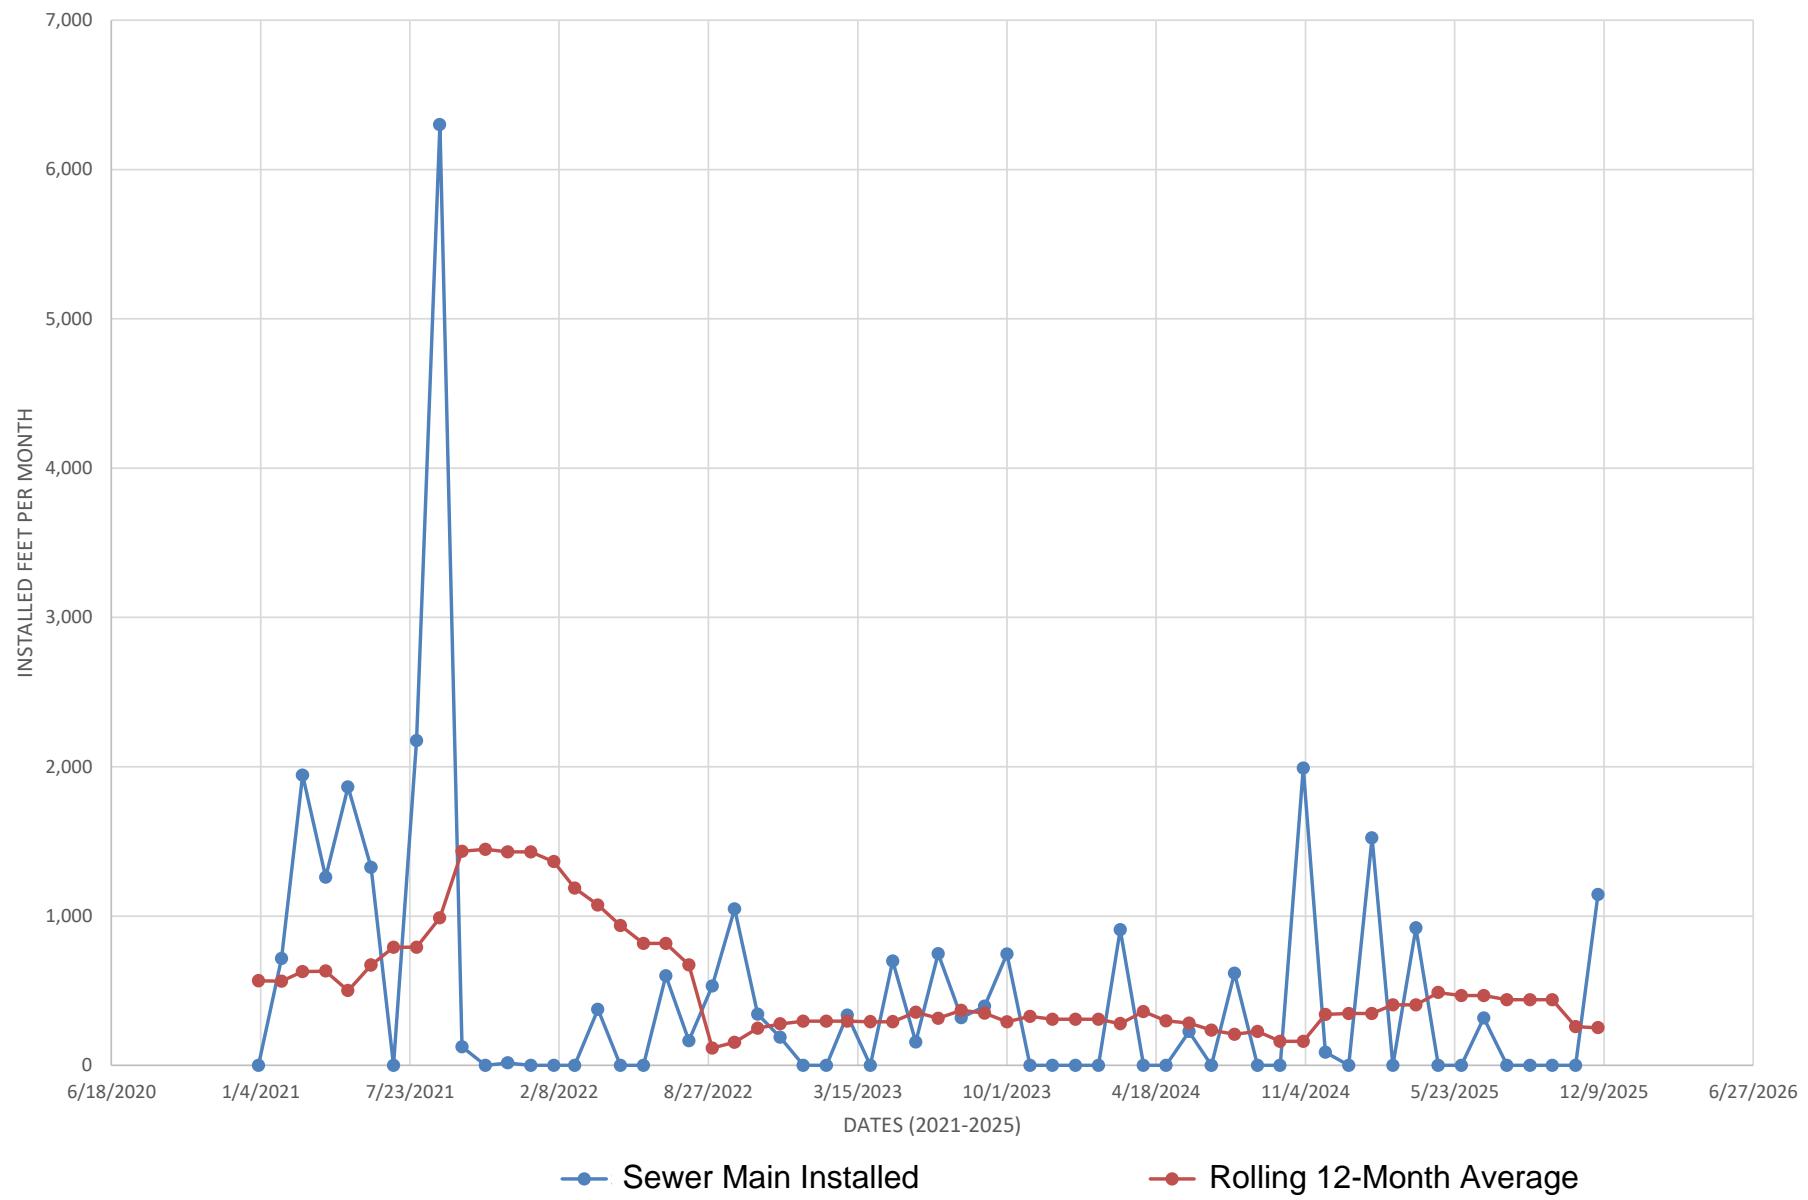

BCRSD - UTILITY ONE CALL LOCATES (2021-2026)

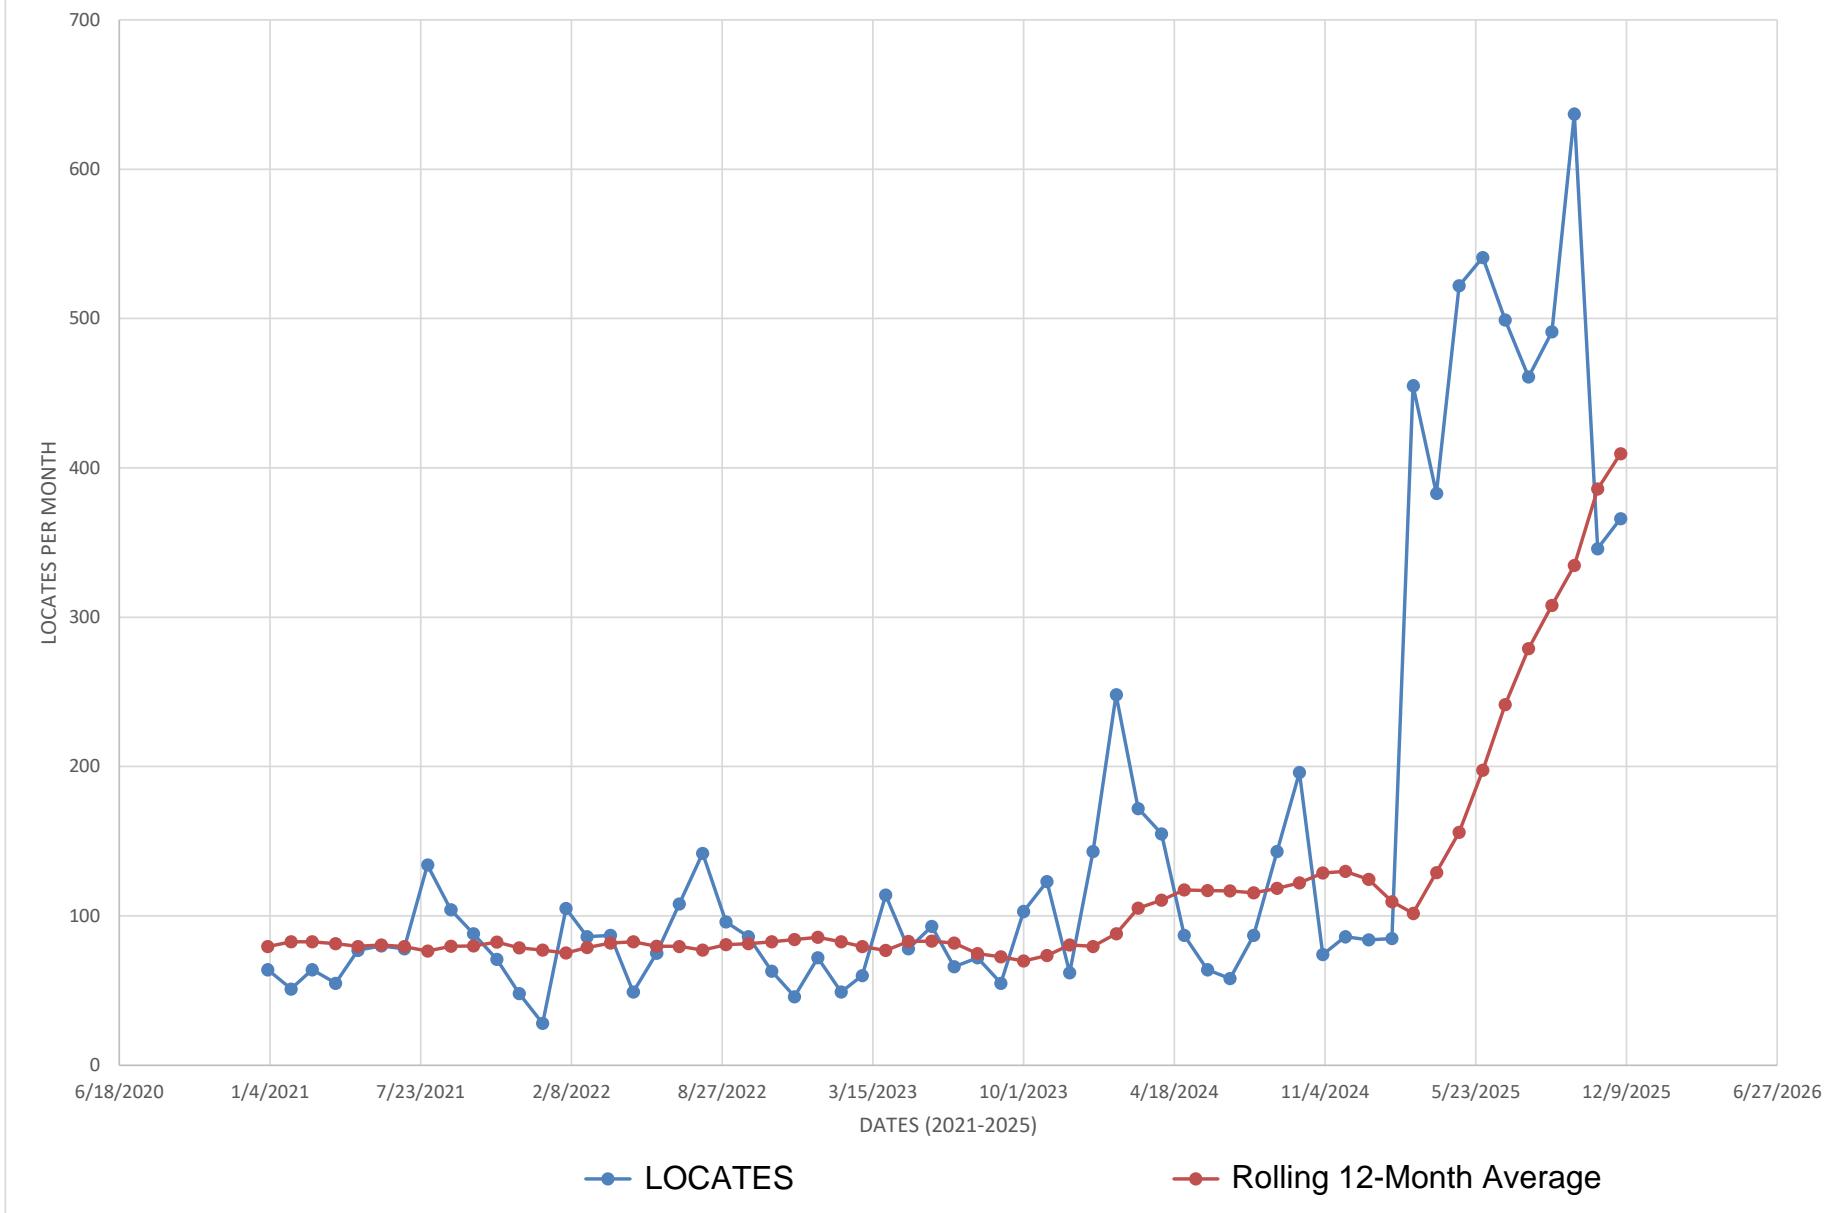

BCRSD - GRAVITY LINE MAINTENANCE (2021-2026)

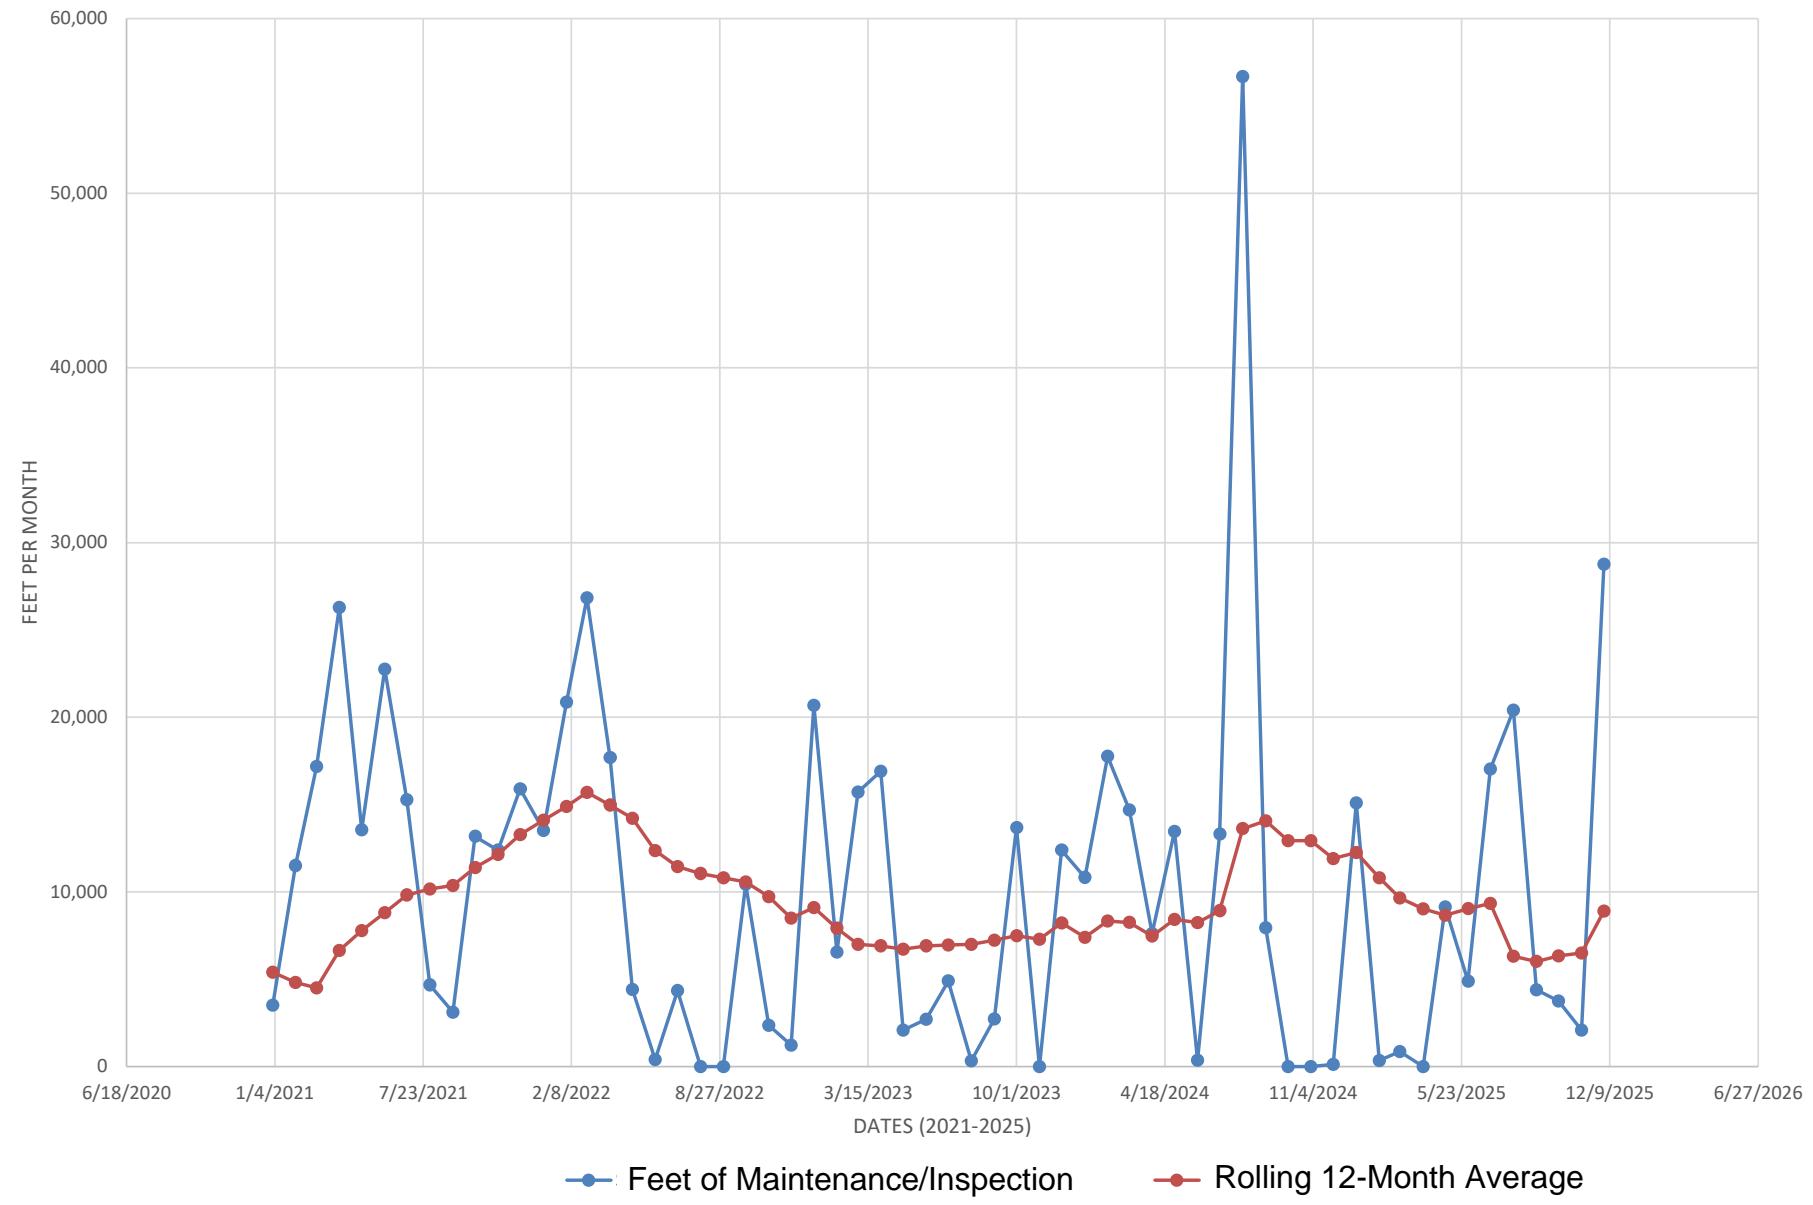

**Boone County Regional Sewer District
Operations and Maintenance Report
Jason Horton
December 2025**

Line Maintenance –

SL Rat 20,369

Root saw 6,938

CCTV

District main blockage – 3 1715 El Chaparral, South Gate way Blvd, 235 Apple Tree Ct

Pumps pulled for service – Concorde East- replaced pump 2 with Barnes Razr, Clearview south pump 2

Pressure Service Calls - 12	Hill creek - 3	Brookfield - 2
	Kinkade- 2	
	The Woodlands – 4	
	Fall Creek - 1	

Private Gravity Service Calls - 3

Contract Service Calls - 0

WWTP / Lift Station Alarm Calls – 1 Concorde east pump failure

MO DNR Inspections – 2 12/3/2025 High field Acres & Trails west

MO One Calls – Received 391, Located 366

Sludge – 5,000 gallons. New Vac truck has been ordered. Expected delivery by end of February. Only using old vac truck when absolutely necessary.

NPDES Permits – We currently have 3 Expired NPDES Permits.
American Outdoor Brands, Eagle Knoll and Twin Lakes.

On Going and Planned Activities – Haul and process sludge. Routine line maintenance, SL Rat

Upcoming Training: Trenching and Shoring at MPUA

Robbie will be taking Class C wastewater license in the spring to advance his license. Caleb still needs to retake his Class C test for license. Seth should obtain his Class C license January 15th when he gains enough experience to receive the license.

Contract Operations;

Ashland – One employee assigned full time. Ashland hired a Class A Operator on 11/17/2025. Contract renewal for 2026 has not been mentioned by Ashland.

Hartsburg – Twice weekly visits to check lift station and lagoon monitoring.