



BCRSD - GRAVITY LINE MAINTENANCE (2021-2026)

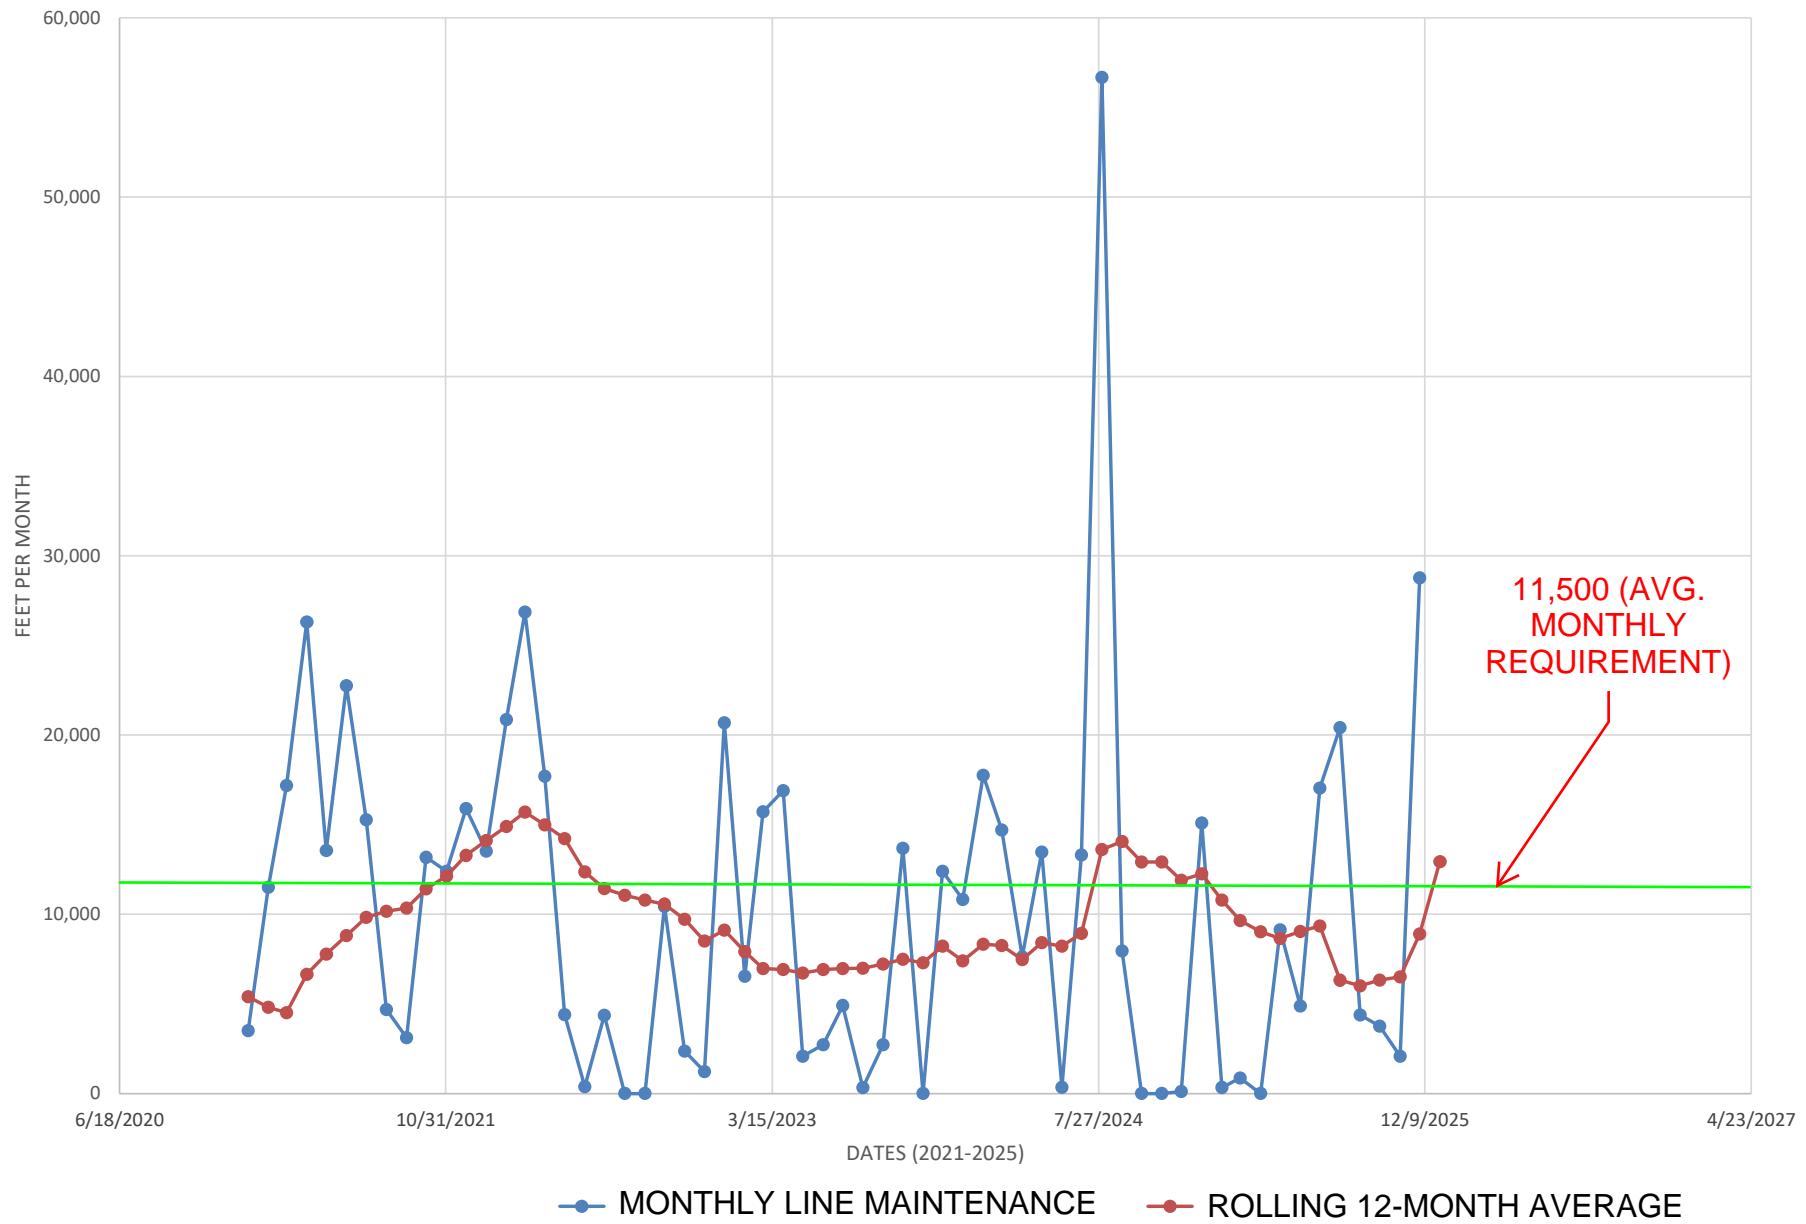

BCRSD - UTILITY ONE CALL LOCATES (2021-2026)

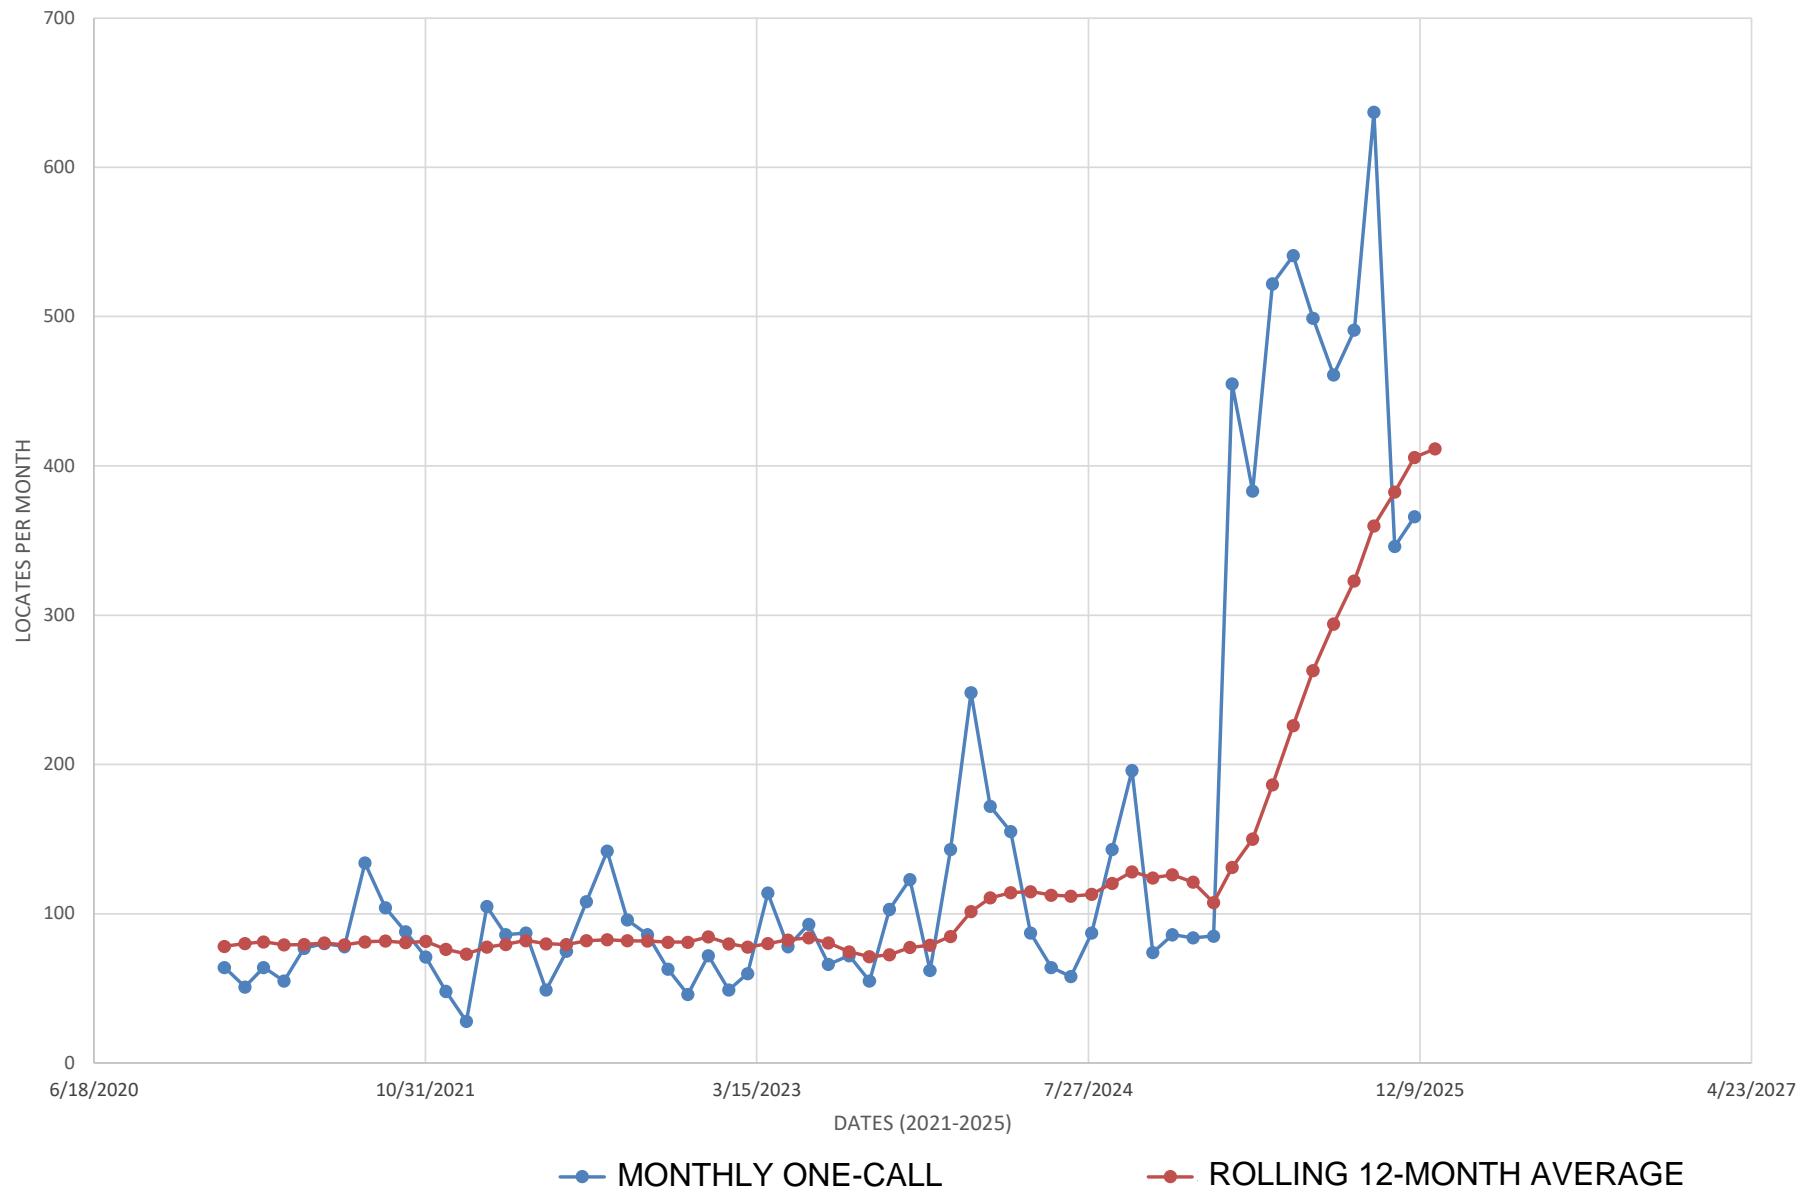

**Boone County Regional Sewer District
Operations and Maintenance Report
Jason Horton
January 2026**

Line Maintenance –

- 55,001' ft SL-Rat.
- 5392' Root Saw
- CCTV 3166'

District main blockage – 0

Pumps pulled for service – New check valve installed in El Rey Lift station

Pressure Service Calls - 16	Woodland - 3	Lake Capri - 4
	Hill Creek - 3	Brookfield - 1
	Arrowhead - 1	Brown Station - 1
	Kinkade - 1	Clear Creek -2

Private Gravity Service Calls - 2 - Private problem service calls.

Contract Service Calls – 0

WWTP / Lift Station Alarm Calls –

MO DNR Inspections – 0

MO One Calls – Received 318, Located 152

H:\DOCS\Administration\BOARD\BOARD MEETINGS\2026\02-FEBRUARY 2026\REGULAR MEETING\3.
BOARD PACKET\Files From Jesse To Drew\Operations + Maintenance Reports\January 2026 OM
Summary.Docx 1 of 2

Sludge – 5k gallons hauled from St Rt K. Trying to limit use of Vac until New truck arrives.

NPDES Permits – We currently have 3 Expired NPDES Permits.

American Outdoor Brands, Eagle Knoll and Twin Lakes.
Ashland and Hartsburg are also expired.

On Going and Planned Activities – Haul and process sludge. SL Rat. Clay tile and Ductile line replacement in creek near Gretchen Lane

New Construction – The Cedars, Ravenwood, Car Condos, Lot C-2 Newtown
Construction permit for Highfield Acres has been granted from DNR.

Contract Operations;

Ashland – One employee assigned full time. Official end date 4-30-2026