

BOONE COUNTY REGIONAL SEWER DISTRICT - SEWER MAINTENANCE SUMMARY

	Service Calls							Sewer Maintenance Activities & Quantities															One Calls	
	District Gravity Main Calls	WWTF & PUMP STATION ALARM	PRIVATE PROBLEM SERVICE CALLS	CONTRACT & EMERGENCY LOCATES	PRESSURE SERVICE CALLS	TOTAL PRESSURE LABOR / MATERIALS COST	AVERAGE PRESSURE COST / CALL	STEP PUMP REPLACEMENT	GRINDER PUMP REPLACEMENT	SEWER MAIN CLEANED BY FLUSHING AND ROOT SAW, LF	CCTV INSPECTION, LF	SL RAT FOOTAGE	Percent of SL Rat that required Jetting	Percent of Gravity System Maintenance completed	Pressure Sewer Repairs	Sewer Main replacement-footage	Sewer Main - New Construction including force main	CIPP Projects completed -footage	MANHOLE ADJUSTED or REPAIRED	MANHOLES RELINED and NEW MANHOLE CONSTRUCTION	Dry Tons of Sludge Disposed	Gallons of Sludge Processed or Disposed	ONE CALL LOCATES - Received	ONE CALL LOCATES -Performed
FISCAL YEAR 2026																								
JANUARY	0	0	2	0	16	\$7,645	\$478	0	2	5,392	3,166	55,001	11%	9%	2	0	0	0	0	0	0	5,000	318	152
FEBRUARY	1	1	3	0	4	\$1,948	\$487	0	1	5,002	2,828	28,673	21%	4%	1	87	273	0	0	2	0	65,000	372	339
MARCH	2	0	1	0	15	\$9,423	\$628	1	4	4,085	1,466	19,370	27%	3%	1	0	0	0	0	0	0	79,600	457	432
APRIL	3	2	2	0	19	\$13,474	\$709	3	3	2,896	1,933	42,831	7%	7%	4	0	0	0	0	0	103.29	92,500	451	437
MAY	0	2	1	0	16	\$9,824	\$614	2	2	26,456	1,767	13,592	16%	5%	0	6	0	0	2	0	0	5,000	423	396
JUNE	0	1	0	0	25	\$13,106	\$524	3	2	24,026	2,736	472	2%	4%	0	10	0	0	0	0	0	2,500	326	314
JULY	0	0	1	0	14	\$7,578	\$541	3	1	3,240	7,294	0	0	2%	2	20	0	0	0	0	0	5,000	374	353
AUGUST	0	5	2	0	15	\$8,781	\$585	2	0	472	1,670	0	0	1%	2	0	0	2,100	0	0	0	5,000	356	349
SEPTEMBER																								
OCTOBER																								
NOVEMBER																								
DECEMBER																								
TOTAL	6	11	12	0	124	\$71,779	\$579	14	15	71,569	22,860	159,939			12	123	273	2,100	2	2	103	259,600	2,021	2,772
AVERAGE	1	1	2	0	16	\$8,972	\$571	2	2	8,946	2,858	19,992	0	0	2	15	34	263	0	0	13	32,450	404	347

**Boone County Regional Sewer District
Operations and Maintenance Report
Jason Horton
August 2026**

Line Maintenance

SL Rat – 0
Root Saw/Jetting - 470 ft
CCTV – 1670 ft

District main blockage – 0

Pumps pulled for service – Rollingwood, Prairie Meadows, Nursery Heights

Pressure Service Calls – 15	Woodlands - 6	Hill Creek - 5
	Kinkade Crossing - 1	Brookfield - 1
	Lake Capri - 1	County Downes - 1

Private Gravity Service Calls – 2

Contract Service Calls – 0

WWTP / Lift Station Alarm Calls – Prairie Meadows pumps tripping due to faulty check valves. Replaced both check valves. Nursery Heights pump trip due to debris. Midway Heights Elementary power failure caused by blown fuses on pole and in panel. Hillview Acres had a clogged pump and changed check valves.

MO DNR Inspections – 0


MO One Calls – Received 356, Located 349

Sludge Processed/Hauled – 5000 gallons hauled

Ongoing and Planned Activities – Haul and process sludge. Keep line maintenance caught up. Tank cleaning and right-of-way cleaning.

Upcoming Training – Caleb and Seth will be attending an Advanced Electrical Class in September.

BCRSD - GRAVITY LINE MAINTENANCE (2021-2026)

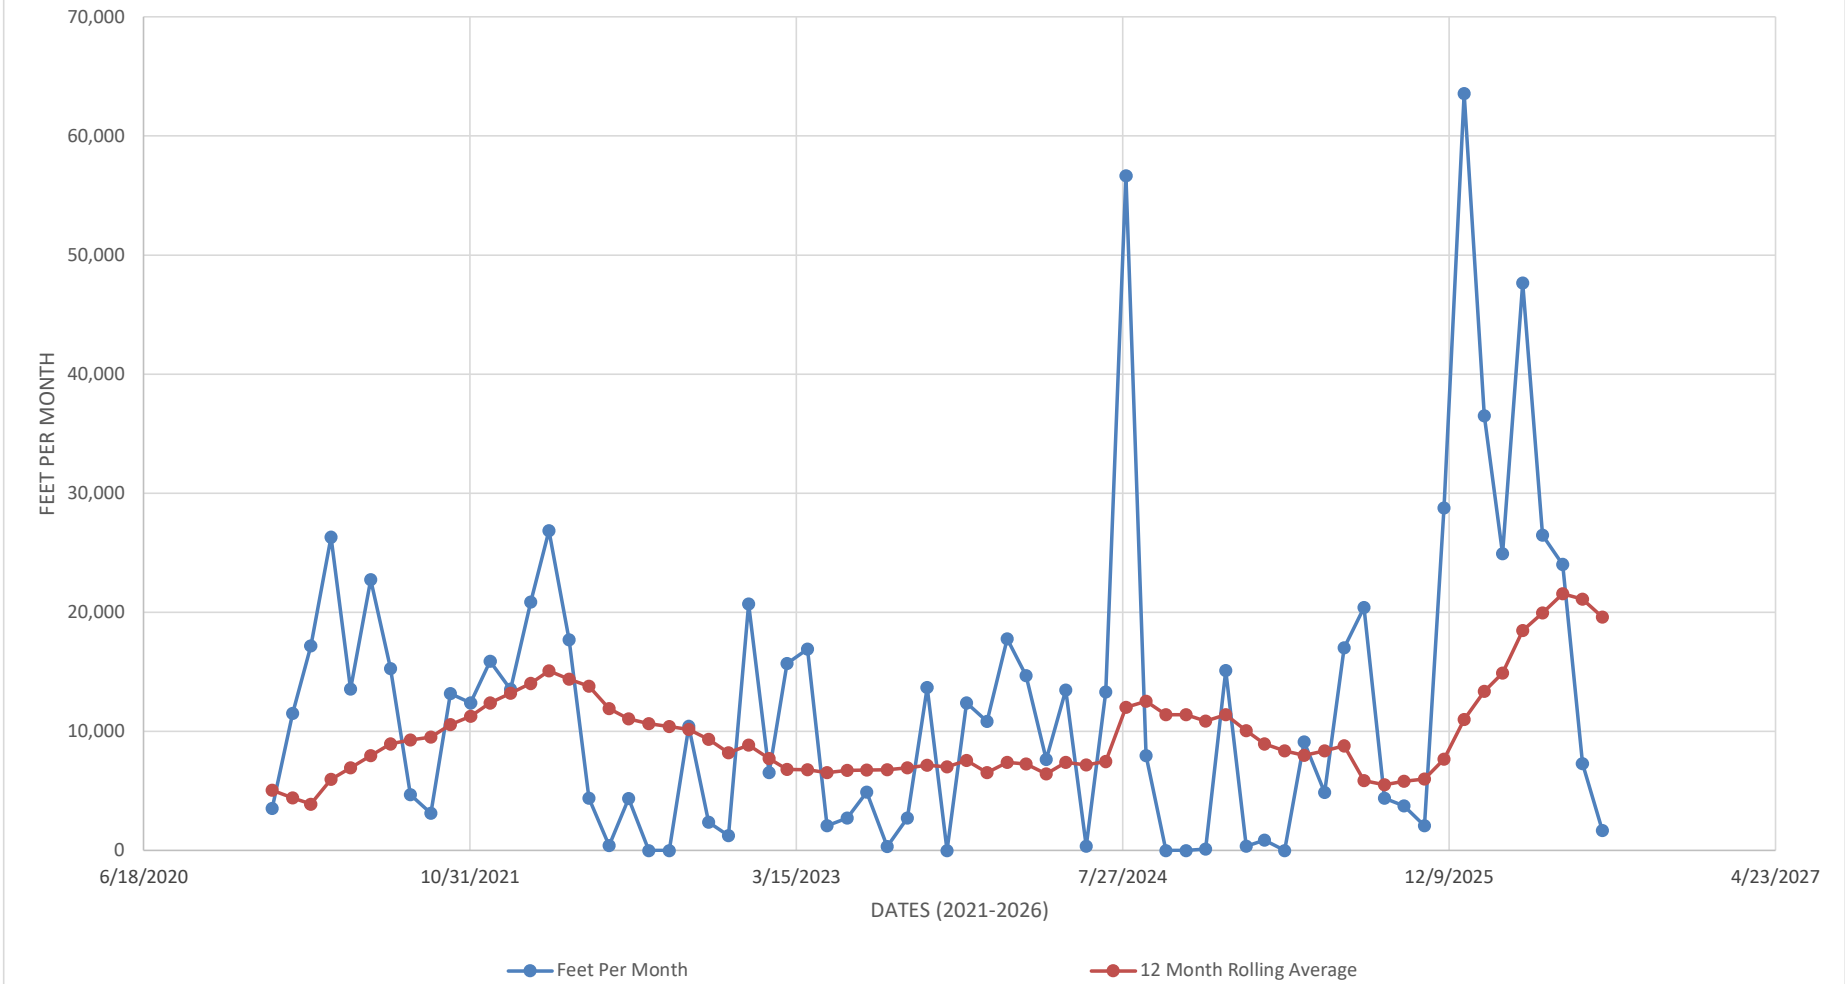

BCRSD - UTILITY ONE CALL LOCATES (2021-2026)

